

OHBA  
INSULATING  
METHOD

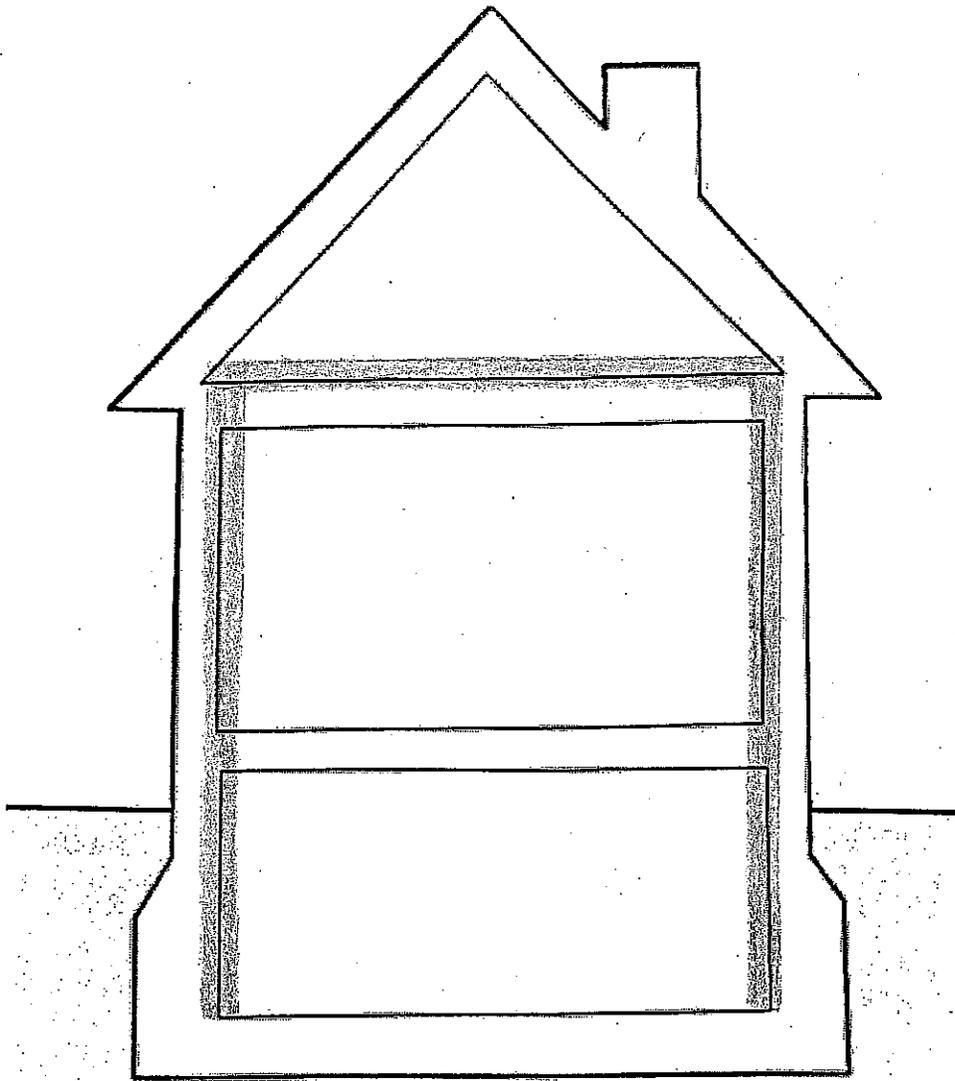


Table 402.1.1 (IECC Prescriptive)  
Insulation and Fenestration Requirements by Component<sup>a</sup>

Climate Zone	Fenestration U-Factor <sup>b</sup>	Skylight <sup>b</sup> U-Factor	Glazed Fenestration SHGC <sup>b, e</sup>	Ceiling R-Value	Wood Frame Wall R-Value	Mass Wall R-Value <sup>f</sup>	Floor R-Value	Basement Wall <sup>c</sup> R-Value	Slab <sup>d</sup> R-Value and Depth	Crawl Space <sup>c</sup> Wall R-Value
4	0.35	0.60	NR	38	13	5/10	19	10/13	10, 2 ft.	10/13
5	0.35	0.60	NR	38	20 or 13 + 5 <sup>h</sup>	13/17	30 <sup>g</sup>	10/13	10, 2 ft.	10/13

Table 1102.1 (RCO Prescriptive)  
Insulation and Fenestration Requirements by Component<sup>a</sup>

Climate Zone	Fenestration U-Factor <sup>b</sup>	Skylight <sup>b</sup> U-Factor	Glazed Fenestration SHGC <sup>b, e</sup>	Ceiling R-Value	Wood Frame Wall R-Value	Mass Wall R-Value <sup>f</sup>	Floor R-Value	Basement Wall <sup>c</sup> R-Value	Slab <sup>d</sup> R-Value and Depth	Crawl Space <sup>c</sup> Wall R-Value
4	0.35	0.60	NR	38	13	5/10	19	10/13	10, 2 ft.	10/13
5	0.35	0.60	NR	38	20 or 13 + 5 <sup>h</sup>	13/17	30 <sup>g</sup>	10/13	10, 2 ft.	10/13