

IECC OR RCO
INSULATING METHODS

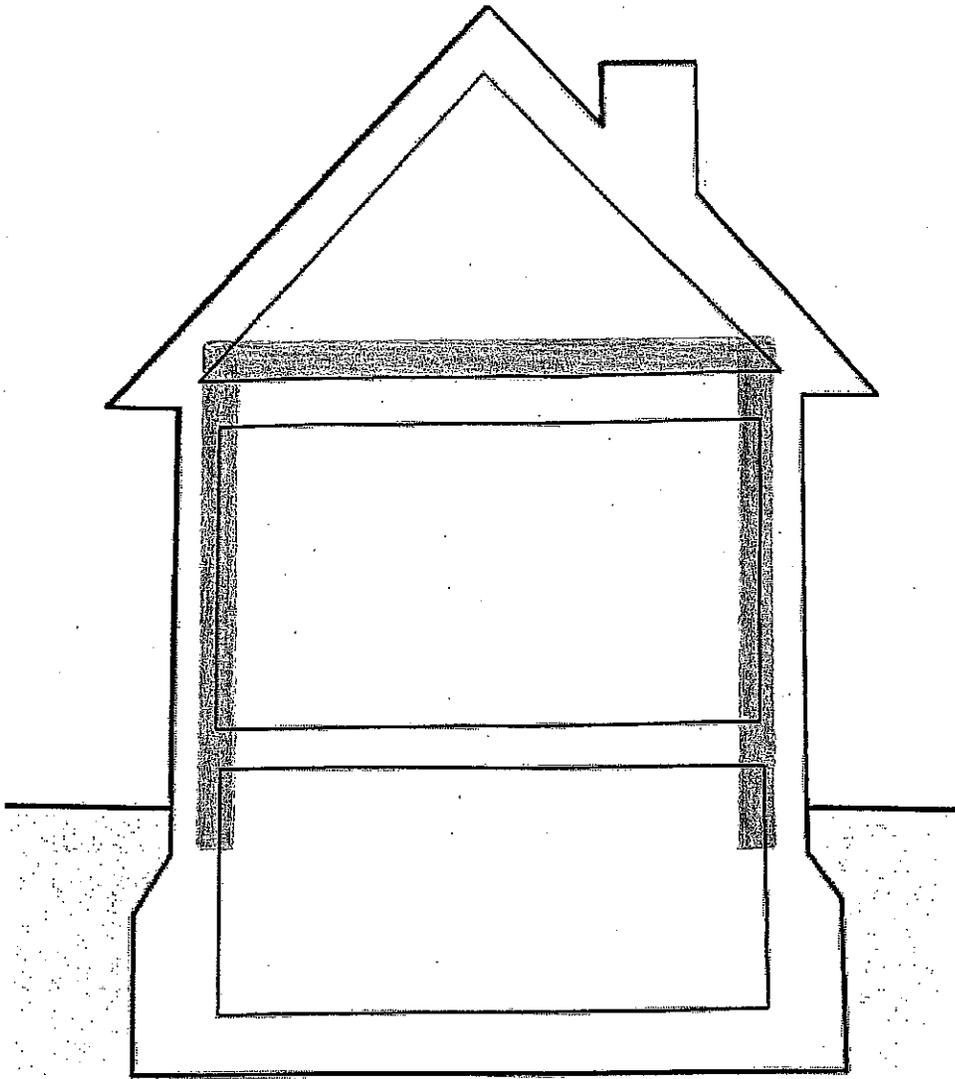


Table 1105.2.1 (©HBA Prescriptive)
Insulation and Fenestration Requirements by Component^a

Compliance Path	Fenestration U-Factor ^b	Skylight U-Factor ^b	Glazed Fenestration SHGC ^{b, e}	Ceiling R-Value	Wood Frame Wall R-Value	Mass Wall R-Value ⁱ	Floor R-Value	Basement ^c Wall R-Value	Slab ^d R-Value and Depth	Crawl Space ^c Wall R-Value
Path #1	0.32	0.60	NR	49	15 or	13/17	30 ^g	10/13 (min. 4ft.)	10, 2 ft.	10/13
					13 + 3 ^h					
Path #2	0.32	0.60	NR	49	13	13/17	30 ^g	10/13 (min. 4ft.)	10, 2 ft.	10/13